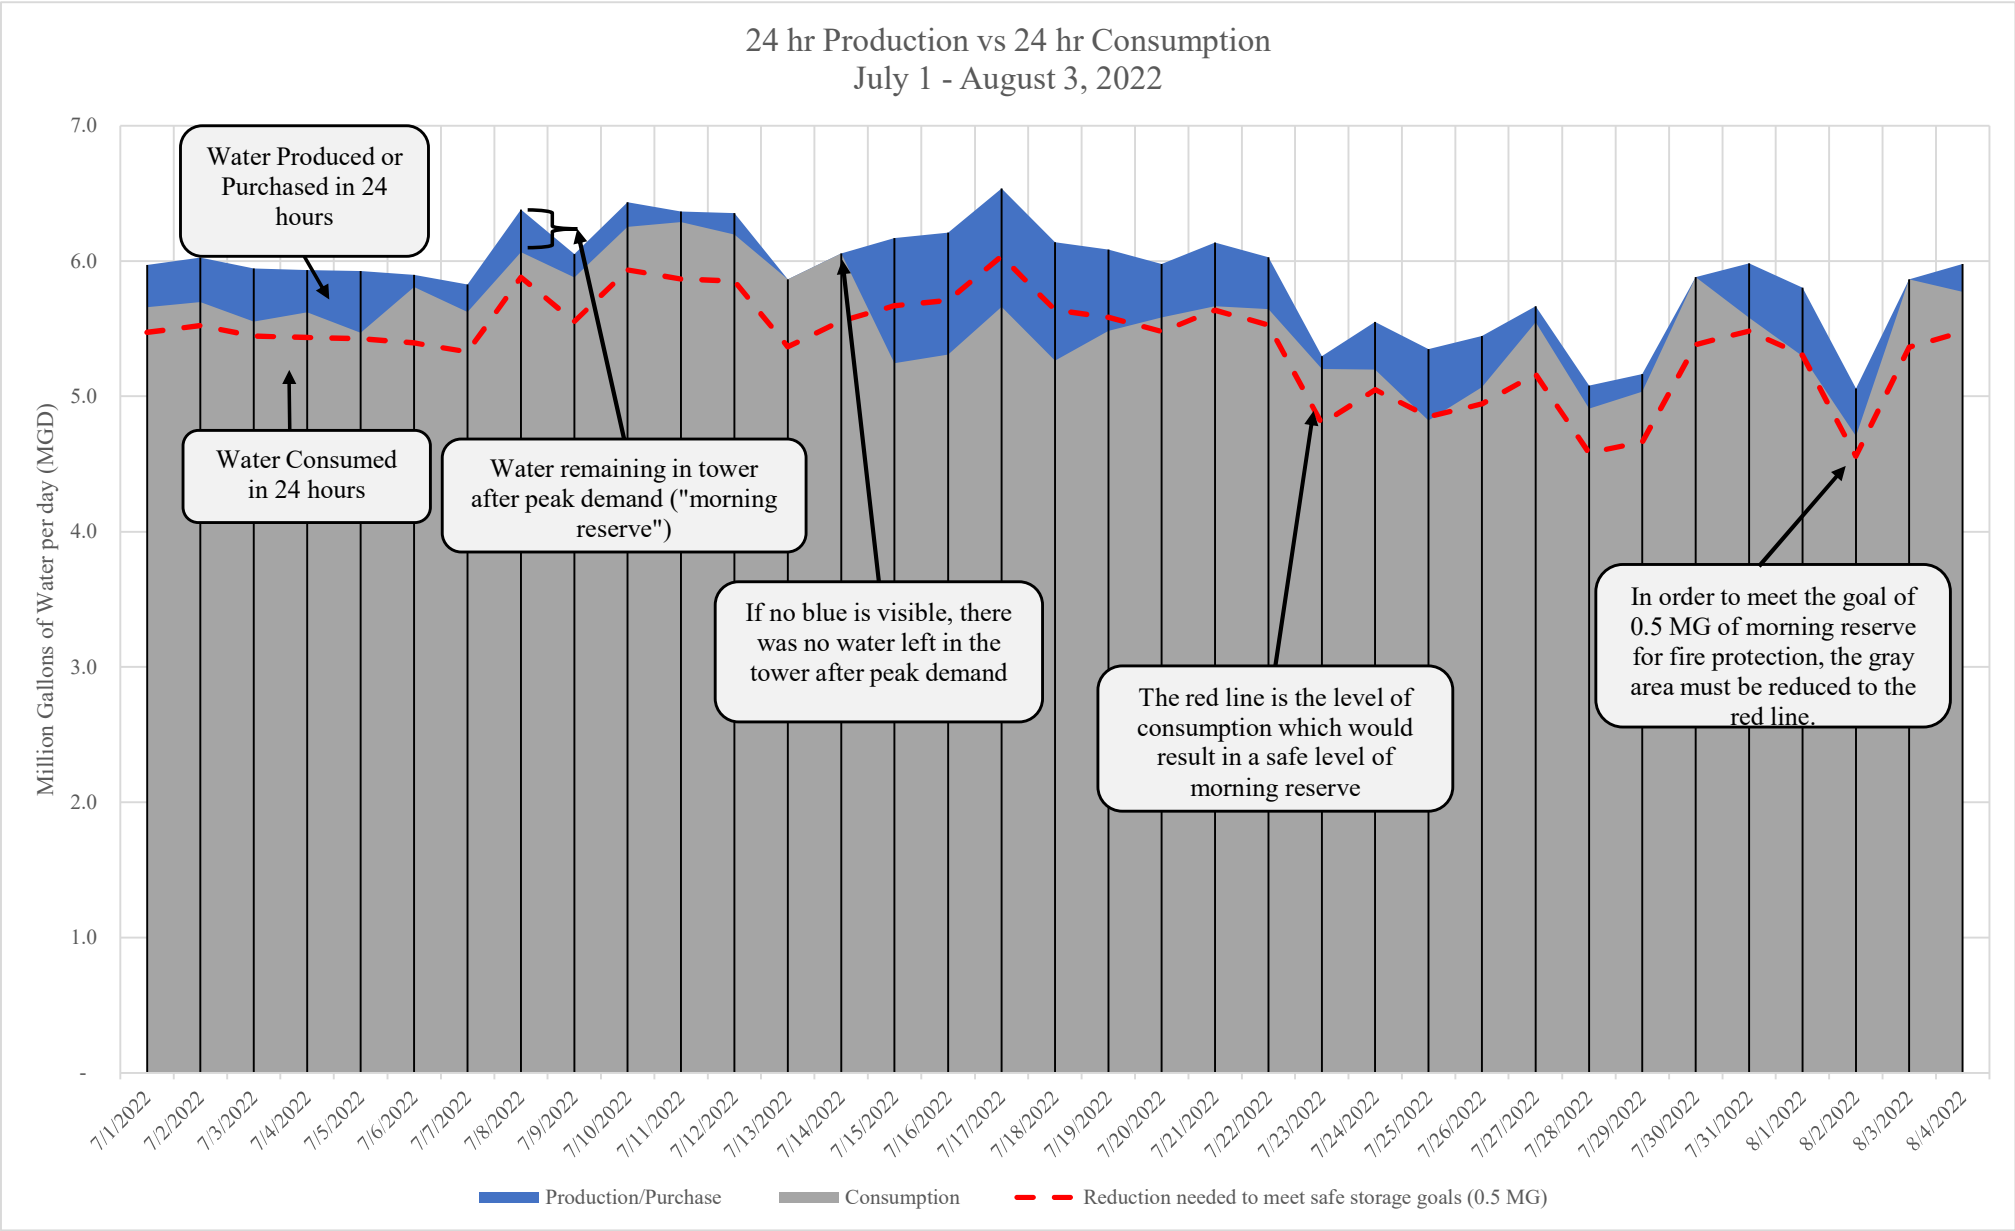
24 hr Production vs 24 hr Consumption
July 1 - August 3, 2022
Million Gallons of Water per day (MGD)
7.0
6.0
5.0
4.0
3.0
2.0
1.0
-
Water Produced or Purchased in 24 hours
Water Consumed in 24 hours
Water remaining in tower after peak demand ("morning reserve")
If no blue is visible, there was no water left in the tower after peak demand
The red line is the level of consumption which would result in a safe level of morning reserve
In order to meet the goal of 0.5 MG of morning reserve for fire protection, the gray area must be reduced to the red line.
7/1/2022
7/2/2022
7/3/2022
7/4/2022
7/5/2022
7/6/2022
7/7/2022
7/8/2022
7/9/2022
7/10/2022
7/11/2022
7/12/2022
7/13/2022
7/14/2022
7/15/2022
7/16/2022
7/17/2022
7/18/2022
7/19/2022
7/20/2022
7/21/2022
7/22/2022
7/23/2022
7/24/2022
7/25/2022
7/26/2022
7/27/2022
7/28/2022
7/29/2022
7/30/2022
7/31/2022
8/1/2022
8/2/2022
8/3/2022
8/4/2022
Production/Purchase
Consumption
Reduction needed to meet safe storage goals (0.5 MG)